



**FIRE DEPARTMENT**  
**FIRE PREVENTION STANDARD NO. 4**


DEVELOPED BY - FIRE MARSHAL

PAGE 1 OF 1

R. Jaylor  
 APPROVED BY - FIRE CHIEF


PAST EDITIONS  
 NONE

DATE: 7/1/92

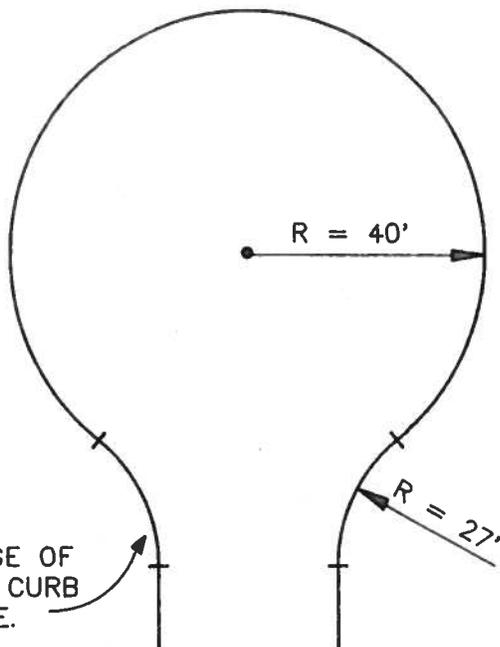


**BULB TURNAROUND**

Fire Lane Sign As Appears Must Be Installed On All Turnarounds At Specified Locations.

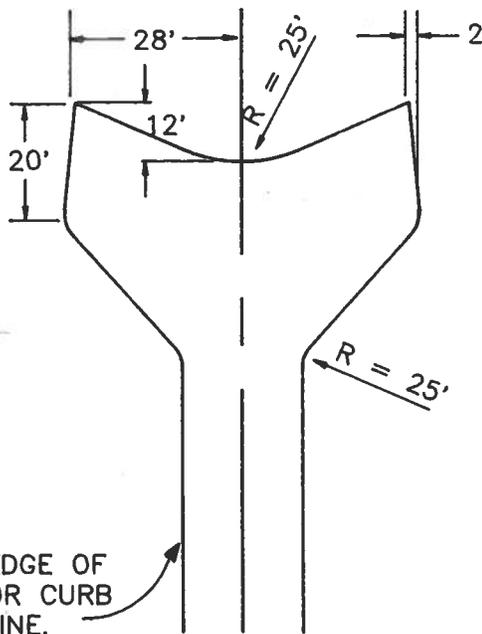


**TURNAROUND**

Fire Lane Sign As Appears Must Be Installed On All Turnarounds At Specified Locations.

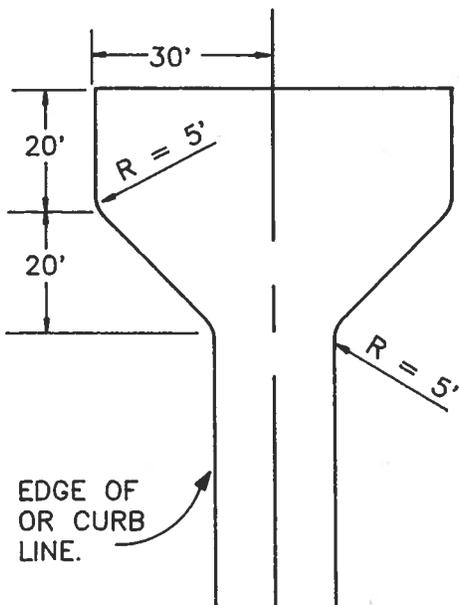

**HAMMERHEAD TURNAROUND**

Fire Lane Sign As Appears Must Be Installed On All Turnarounds At Specified Locations.



FIRE LANE SIGN Shall Be Set Per City Standard **ST10**

**FIRE LANE SIGN**  
 12' x 18'  
 Red on White  
 Reflectorized .080 Gauge

**NOTES:**

1. All Signs And Curb Markings Are To Be Installed And Maintained By The Property Owner.
2. Detailed Plans Of The Proposed Fire Lane Markings Shall Be Provided To The Fire Prevention Bureau For Review Prior To Installation.
3. Signs Marking FIRE LANES Are To Be Spaced So They Are Within Three (3) Feet Of Each End Of Curbed Areas And Spaced A Minimum Of One Hundred (100) Feet Apart Thereafter.
4. In Addition, One (1) Sign Is Required For Each Island Adjacent To A Fire Lane Or Access Road If The Road Width Is Less Than Twenty (20) Feet.
5. Signs Are To Face Oncoming Vehicular Traffic.
6. All curbs Adjoining Fire Lanes Or Posted Areas Shall Be Painted Red And Labeled.